



Art.-Nr: LMW019ML
Exit sign Centralised power supply systems
Wall mounting, CPS, 22 m, IP40, Aluminium, Anodised
aluminium, Set of pictograms

Robust emergency exit sign luminaire made from slim aluminium profile, for wall mounting.

The additional downward light emission helps to illuminate emergency and escape routes.

Control and monitoring via central power supply system. Planning certainty is provided by tool-free, variable use of the pictograms on site. A set of pictograms corresponding to DIN ISO 7010 (arrow to the right, left, up and down) is supplied as standard.



More information
www.rp-group.com/en/item/LMW019ML



TECHNICAL DATA


Luminaire type	Exit sign
Mounting	Wall mounting
Recognition distance	22 m
Pictograph	Set
Illuminant	LED
Housing material	Aluminium
Housing color	Anodised aluminium
Protection type (IP)	IP40
Impact resistance (IK)	3
Certification	WEEE, CE
Insulation class	1
Supply	Centralised power supply systems
Monitoring	Central power supply (ML)
Bridging time	CPS
Battery	/
Operating mode	single luminaire switching
Input voltage AC	230 V
Input frequency	50 / 60 Hz



Input voltage DC	216 V
Power max.	5,2 W
Power maintained	5,2 W
Power non-maintained	1,1 W
Ambient temperature maintained mode	-20 °C to 40 °C
Ambient temperature non-maintained mode	-20 °C to 40 °C
Depth	62 mm
Width	258 mm
Height	147 mm
Weight	0.89
Weight incl. packaging	0.99
Connection cross-section	2.5 mm ²
Switching input	Yes
Emergency light blocking	No
Battery connection	No
Dimming function	Yes
Luminous flux mains	300 lm
Luminous flux emergency	300 lm
Customs tariff number	94056180
GTIN	4260123682019



TECHNICAL DRAWING

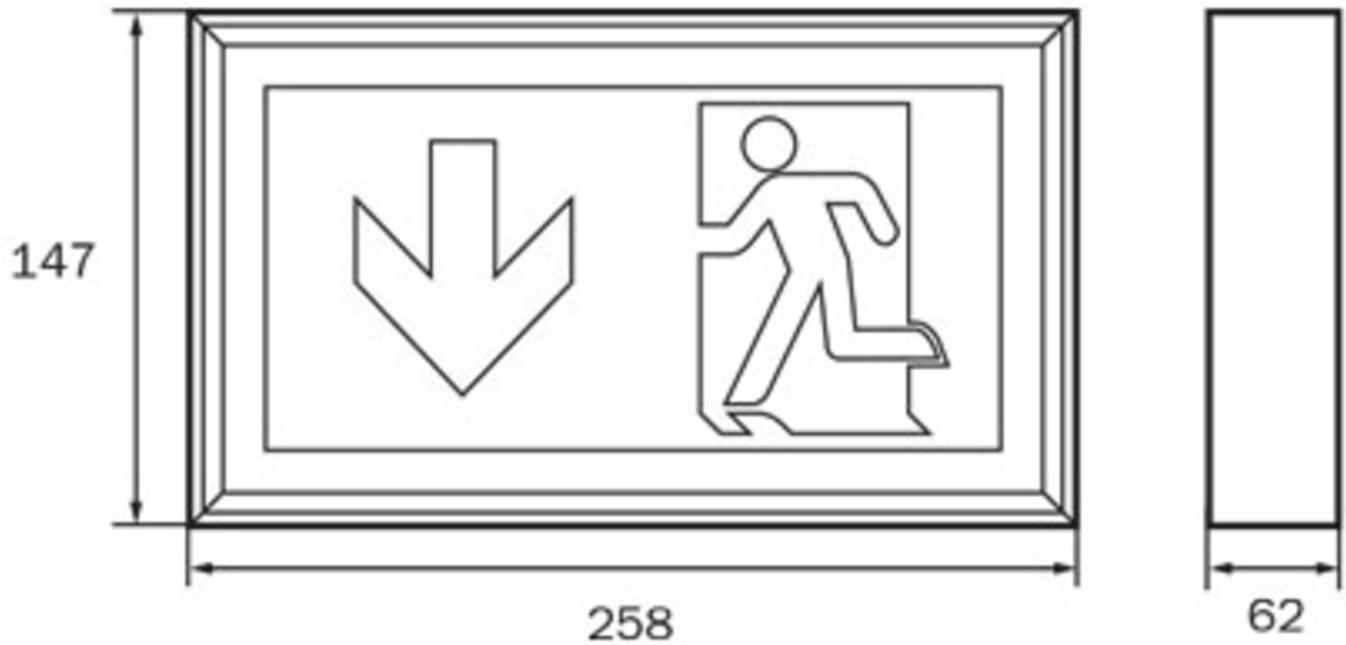

ACCESSORY LIST

BALL1 - Wire mesh guard

AWM001-SI - Professional wall bracket AWM - 90° flag mounting for escape route display

RELATED PRODUCTS

Art.-No.	Image	Monitoring	Supply	Color	Investment	Automatic log	Maintenance level	Remote maintenance	max. luminaires	Single luminaire monitoring
----------	-------	------------	--------	-------	------------	---------------	-------------------	--------------------	-----------------	-----------------------------

As of: 24.08.2026 - Subject to technical changes and errors.