



### Art.-Nr: KCD019ML **Exit sign Centralised power supply systems** Recessed mounting, Central power supply (ML), CPS, 30 m, IP40, Plastic, white

Slim convex plastic emergency exit sign luminaire for ceiling mounting. Suited to inscription on one or two sides. The plug-in set of pictograms is fitted on the inside without the use of solvents.

Control and monitoring via central power supply system. Planning certainty is provided by tool-free, variable use of the pictograms on site. A set of pictograms corresponding to DIN ISO 7010 (arrow to the right, left, up and down) is supplied as standard.















### TECHNICAL DATA

Luminaire type	Exit sign
Mounting	Recessed mounting
Recognition distance	30 m
Pictograph	Set
Illuminant	LED
Housing material	Plastic
Housing color	white
Protection type (IP)	IP40
Impact resistance (IK)	≥ 3
Certification	WEEE, CE, D-Sign, TÜV Rheinland Type approved, ENEC
Insulation class	1
Supply	Centralised power supply systems
Monitoring	Central power supply (ML)
Bridging time	CPS
Battery	/
Operating mode	single luminaire switching
Input voltageAC	230 V
Input frequency	50 / 60 Hz
Input voltage DC	216 V





Power max.	5,2 W			
Power DS	5,2 W			
Power BS	1,1 W			
Ambient temperature DS	-20 °C to 40 °C			
Ambient temperature BS	-20 °C to 40 °C			
Depth	90 mm			
Width	340 mm			
Height	170 mm			
Weight	0.94			
Weight incl. packaging	1.05			
Connection cross-section	2.5 mm <sup>2</sup>			
Switching input	Yes			
Emergency light blocking	No			
Battery connection	No			
Dimming function	Yes			
Luminous flux mains	300 lm			
Luminous flux emergency	300 lm			
Customs tariff number	94056120			
EAN	4260123681579			






# TECHNICAL DRAWING





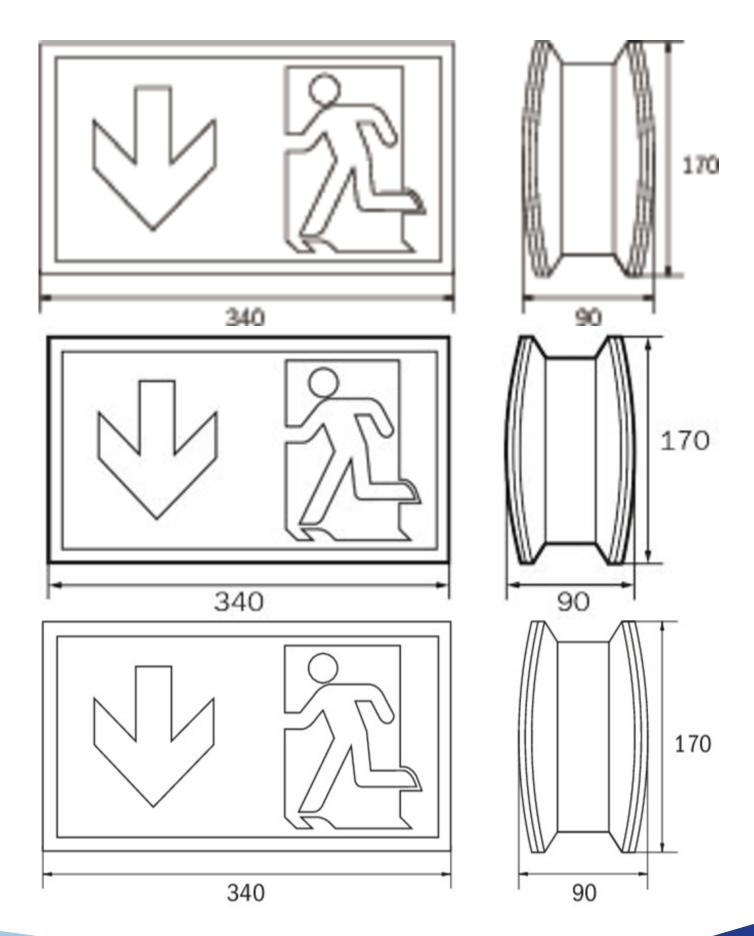





# ACCESSORY LIST

KCAWW - Wall bracket

DSA - Wire suspension

2PW-EB - Pendant

WKL - Eye bolts

# RELATED PRODUCTS

ArtNo.	Image	Monitoring	Supply	Color	Investment	Automatic log	Maintenance level	Remote main- tenance	max. luminai- res	Single luminai- re monitoring
KCD519CC		CoreCompact 24 (CC)	Central power supply	RAL 9003	€€	Yes	low	Yes		central

As of: 20.12.2024 - Subject to technical changes and errors.