



**Art.-Nr: KWID039ML**

**Exit sign, Safety luminaire Centralised power supply systems  
Recessed mounting, Central power supply (ML), CPS, 16 m,  
IP65, Plastic, white**

Classic bar-shaped polycarbonate luminaire for ceiling mounting. Straight lines as well as the robust construction with a high ingress protection allow versatile use.

Control and monitoring via central power supply system. Planning certainty is provided by tool-free, variable use of the pictograms on site. A set of pictograms corresponding to DIN ISO 7010 (arrow to the right, left, up and down) is supplied as standard.



More information

[www.rp-group.com/en/item/KWID039ML](http://www.rp-group.com/en/item/KWID039ML)



## TECHNICAL DATA


Luminaire type	Exit sign, Safety luminaire
Mounting	Recessed mounting
Recognition distance	16 m
Pictograph	Set
Illuminant	LED
Housing material	Plastic
Housing color	white
Protection type (IP)	IP65
Impact resistance (IK)	6
Certification	WEEE, CE, D-Sign, TÜV Rheinland Type approved, ENEC
Insulation class	2
Supply	Centralised power supply systems
Monitoring	Central power supply (ML)
Bridging time	CPS
Battery	/
Operating mode	single luminaire switching
Input voltage AC	230 V
Input frequency	50 / 60 Hz
Input voltage DC	216 V



Power max.	9,7 W
Power maintained	9,7 W
Power non-maintained	1,1 W
Ambient temperature maintained mode	-35 °C to 40 °C
Ambient temperature non-maintained mode	-20 °C to 40 °C
Depth	93 mm
Width	390 mm
Height	139 mm
Weight	0.77
Weight incl. packaging	0.87
Connection cross-section	2.5 mm <sup>2</sup>
Switching input	Yes
Emergency light blocking	No
Battery connection	No
Dimming function	Yes
Luminous flux mains	1050 lm
Luminous flux emergency	1050 lm
Customs tariff number	94056120
EAN	4260659566333



## TECHNICAL DRAWING

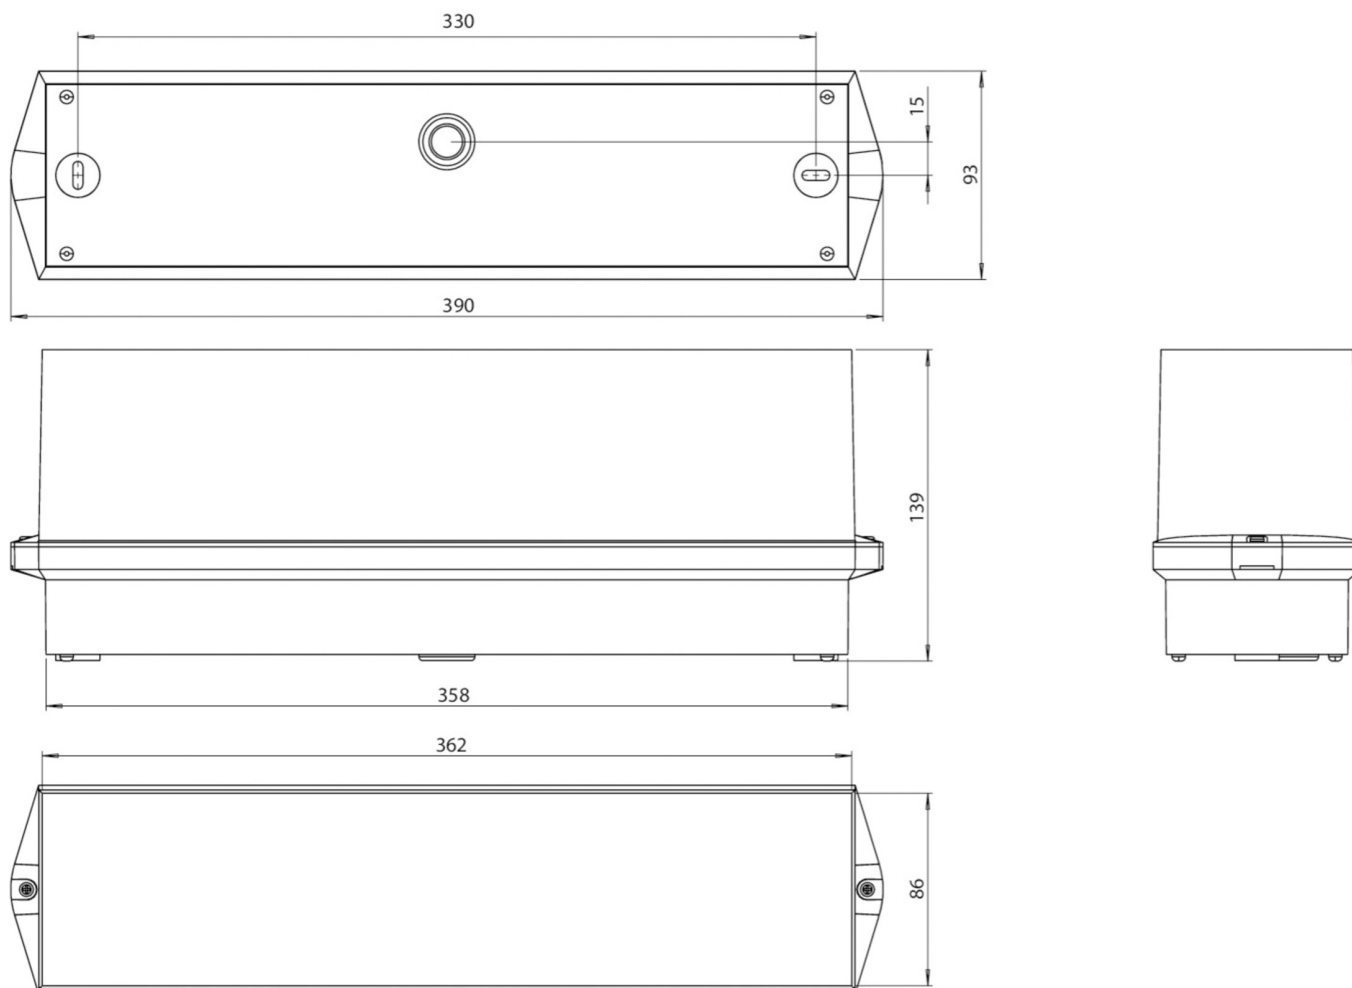

## ACCESSORY LIST

BKW -

## RELATED PRODUCTS

Art.-No.	Image	Monitoring	Supply	Color	Investment	Automatic log	Maintenance level	Remote maintenance	max. luminaires	Single luminaire monitoring
----------	-------	------------	--------	-------	------------	---------------	-------------------	--------------------	-----------------	-----------------------------

As of: 07.02.2025 - Subject to technical changes and errors.