



#### Art.-Nr: LSD019ML Exit sign Centralised power supply systems Recessed mounting, Central power supply (ML), CPS, 56 m, IP40, Aluminium, Anodised aluminium

Robust emergency exit sign luminaire made from slim aluminium profile, for ceiling mounting. Suited to inscription on one or two sides.

The additional downward light emission helps to illuminate emergency and escape routes.

Control and monitoring via central power supply system. Two requested pictograms (arrow to the right, left, up, down or white) are supplied as standard.





More information www.rp-group.com/en/item/LSD019ML



#### **TECHNICAL DATA**

Luminaire type	Exit sign					
Mounting	Recessed mounting					
Recognition distance	56 m					
Pictograph	acc. to Specification					
Illuminant	LED					
Housing material	Aluminium					
Housing color	Anodised aluminium					
Protection type (IP)	IP40					
Impact resistance (IK)	≥ 3					
Certification	WEEE, CE					
Insulation class	1 Centralised power supply systems					
Supply						
Monitoring	Central power supply (ML)					
Bridging time	CPS					
Battery	/					
Operating mode	single luminaire switching					
Input voltageAC	230 V					
Input frequency	50 / 60 Hz					
Input voltage DC	216 V					





Power max.	9,3 W					
Power DS	9,3 W					
Power BS	1,1 W					
Ambient temperature DS	-20 °C to 40 °C					
Ambient temperature BS	-20 °C to 40 °C					
Depth	62 mm					
Width	614 mm					
Height	334 mm					
Weight	2.2					
Weight incl. packaging	2.2					
Connection cross-section	2.5 mm <sup>2</sup>					
Switching input	Yes					
Emergency light blocking	No					
Battery connection	No					
Dimming function	Yes					
Luminous flux mains	600 lm					
Luminous flux emergency	600 lm					
Customs tariff number	94056180					
EAN	4260123682873					






## TECHNICAL DRAWING





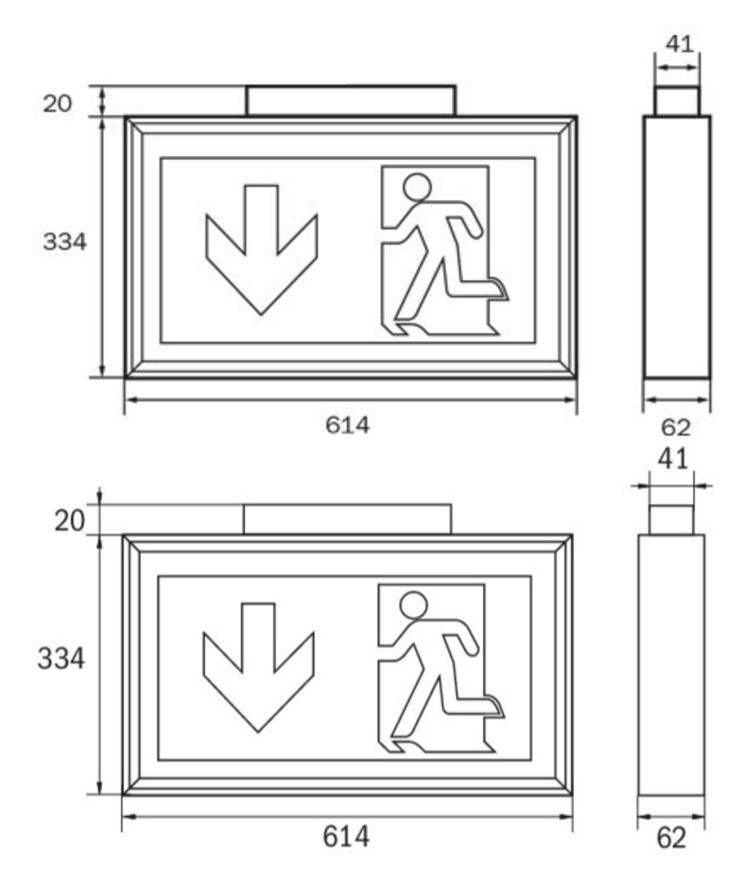





## **ACCESSORY LIST**

DSA - Wire suspension

2PS-EB - Pendant

# RELATED PRODUCTS

								Maintanana	D d		Oin ale leurein ei
ArtNo.	Image	Monitoring	Supply	Color	Investment	Automatic log		Remote main-	max. iuminai-	Single luminai-	
							level	tenance	res	re monitoring	

As of: 27.11.2024 - Subject to technical changes and errors.