Art.-Nr: PMD029
Exit sign, Emergency light Centralised power supply systems Surface mounting, CPS, 20 m, IP65, Polycarbonate, White

Plastic emergency exit sign luminaire with trapezoid surround.

To help with mounting, levelling screws are integrated to compensate for uneven surfaces.

The luminaire can be mounted by fitting on the wall and ceiling as well as fitting in the ceiling in conjunction with the mounting frame available.

The set of pictograms is inserted on the inside and secured without the use of solvents.

Planning certainty is provided by tool-free, variable use of the pictograms on site. A set of pictograms corresponding to DIN ISO 7010 (2x man in the door and 2 straight arrows) are supplied as standard. The luminaire is fitted with the innovative **flexible plug-in system** for rapid use of the right lens. The hall lens is supplied with every luminaire. A round lens, spotlight lens and beam lens are available as options.

More information
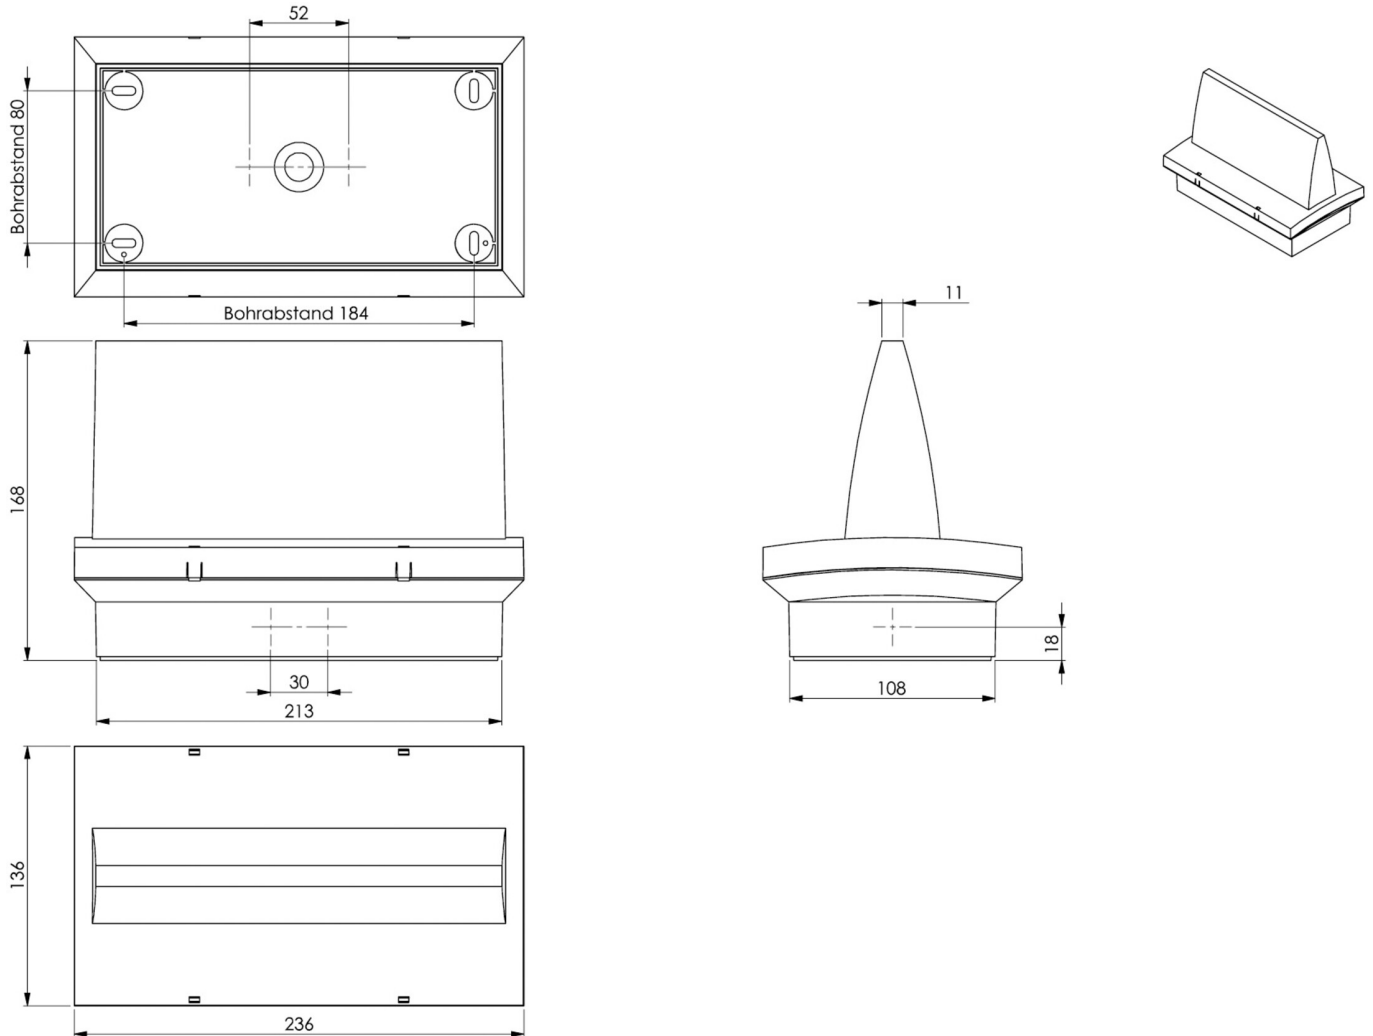www.rp-group.com/en/item/PMD029

TECHNICAL DATA

Luminaire type	Exit sign, Emergency light
Mounting	Surface mounting
Recognition distance	20 m
Pictograph	Set
Housing material	Polycarbonate
Housing color	White
Protection type (IP)	IP65
Impact resistance (IK)	≥ 3
Certification	WEEE, CE, D-Sign, HACCP
Insulation class	2
Supply	Centralised power supply systems
Bridging time	CPS
Battery	/
Operating mode	Permanent circuit
Input voltage AC	230 V

Input frequency	50 / 60 Hz
Input voltage DC	100-254 V
Power max.	4,9 W
Power maintained	4,9 W
Power non-maintained	0 W
Ambient temperature maintained mode	-5 °C to 40 °C
Ambient temperature non-maintained mode	-5 °C to 40 °C
Depth	168 mm
Width	236 mm
Height	136 mm
Weight	0.84
Weight incl. packaging	0.94
Connection cross-section	1.5 mm²
Switching input	No
Emergency light blocking	No
Battery connection	No
Dimming function	No
Luminous flux mains	250 lm
Luminous flux emergency	250 lm
Customs tariff number	94056120
GTIN	4262483029633

Bohrabstand 80

52

Bohrabstand 184

168

30

213

136

236

11

108

18

PM-PIKTOSETSONDER.01 -

As of: 04.09.2025 - Subject to technical changes and errors.